


NOTE:  
USE HIGH TEMP SPRINKLER  
HEADS OVER BOILERS

UPRIGHT  
SPRINKLER  
HEAD IN  
BOILER RM  
(TYP)

NOTE:  
THE SPRINKLER SYSTEM SHALL BE HYDRAULICALLY SIZED  
AND INSTALLED TO MEET THE MINIMUM REQUIREMENTS  
OF THE N.F.P.A. AND LOCAL FIRE DEPARTMENT

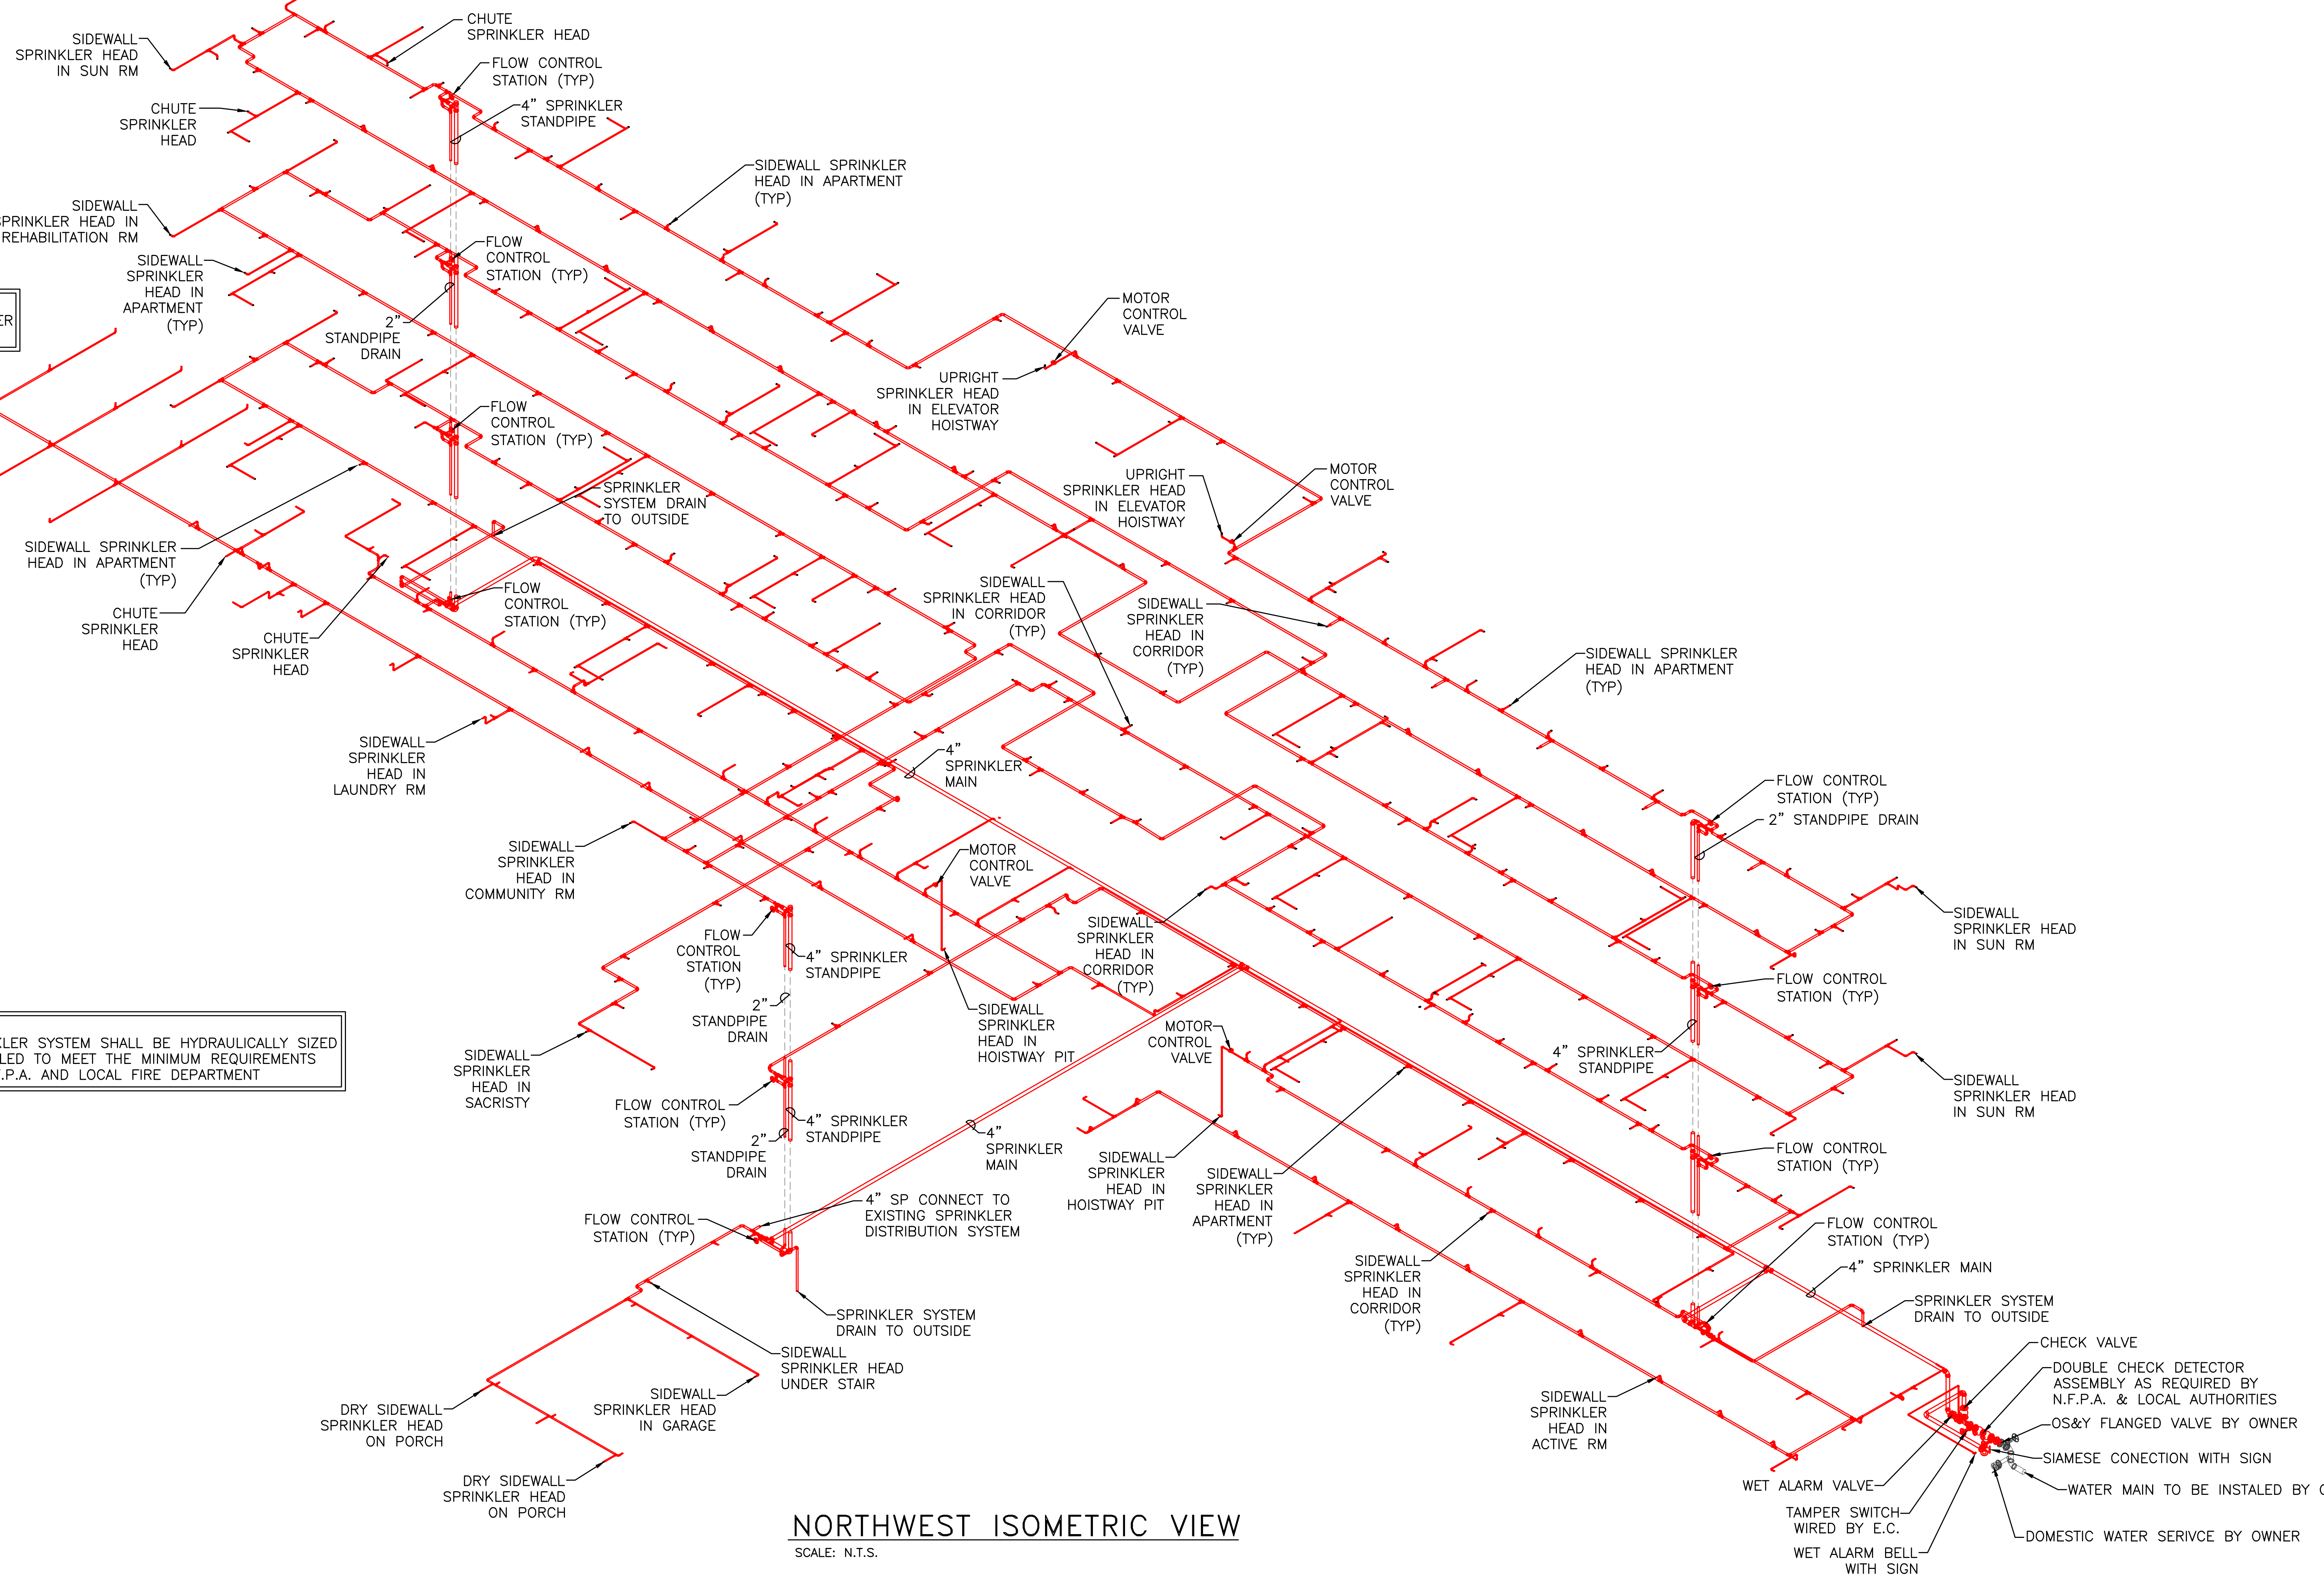

**NORTHWEST ISOMETRIC VIEW**  
SCALE: N.T.S.